

NOTES:


1. THE CITY RECOMMENDS PREFABRICATED CONCRETE WASHOUT CONTAINERS IF A PREFABRICATED CONCRETE WASHOUT CONTAINER IS NOT UTILIZED, THIS DETAIL IS REQUIRED.
2. DETAIL ABOVE ILLUSTRATES MINIMUM DIMENSIONS. PIT CAN BE INCREASE IN SIZE DEPENDING ON EXPECTED FREQUENCY OF USE.
3. WASHOUT PIT SHALL BE LOCATED IN AN AREA EASILY ACCESSIBLE TO CONSTRUCTION TRAFFIC.
4. WASHOUT PIT SHALL NOT BE LOCATED IN AREAS SUBJECT TO INUNDATION FROM STORMWATER RUNOFF.
5. LOCATE WASHOUT AREA AT LEAST 50 FT FROM SENSITIVE FEATURES, FLOODPLAIN, STORM DRAINS, OPEN DITCHES OR WATER BODIES.
6. TEMPORARY WASHOUT FACILITY SHOULD BE CONSTRUCTED WITH SUFFICIENT QUANTITY AND VOLUME TO CONTAIN ALL LIQUID AND CONCRETE WASTE GENERATED BY WASHOUT OPERATIONS.
7. THE CONCRETE WASHOUT SIGN SHALL BE INSTALLED WITHIN 30 FT OF THE TEMPORARY CONCRETE WASHOUT FACILITY.

MATERIALS:

PLASTIC LINING MATERIAL SHOULD BE MINIMUM OF 10 MIL IN POLYETHYLENE SHEETING AND SHOULD BE FREE OF HOLES, TEARS, OR OTHER DEFECTS THAT COMPROMISE THE IMPERMEABILITY OF THE MATERIAL.

MAINTENANCE:

1. WHEN TEMPORARY CONCRETE WASHOUT FACILITIES ARE NO LONGER REQUIRED FOR THE WORK, THE HARDENED CONCRETE SHOULD BE REMOVED AND DISPOSED OF LEGALLY.
2. MATERIALS USED TO CONSTRUCT TEMPORARY WASHOUT FACILITIES SHOULD BE REMOVED FROM THE SITE OF WORK AND DISPOSED LEGALLY.
3. HOLES, DEPRESSIONS OR OTHER GROUND DISTURBANCES CAUSED BY THE REMOVAL OF THE TEMPORARY CONCRETE WASHOUT FACILITIES SHOULD BE BACKFILLED AND REPAIRED.

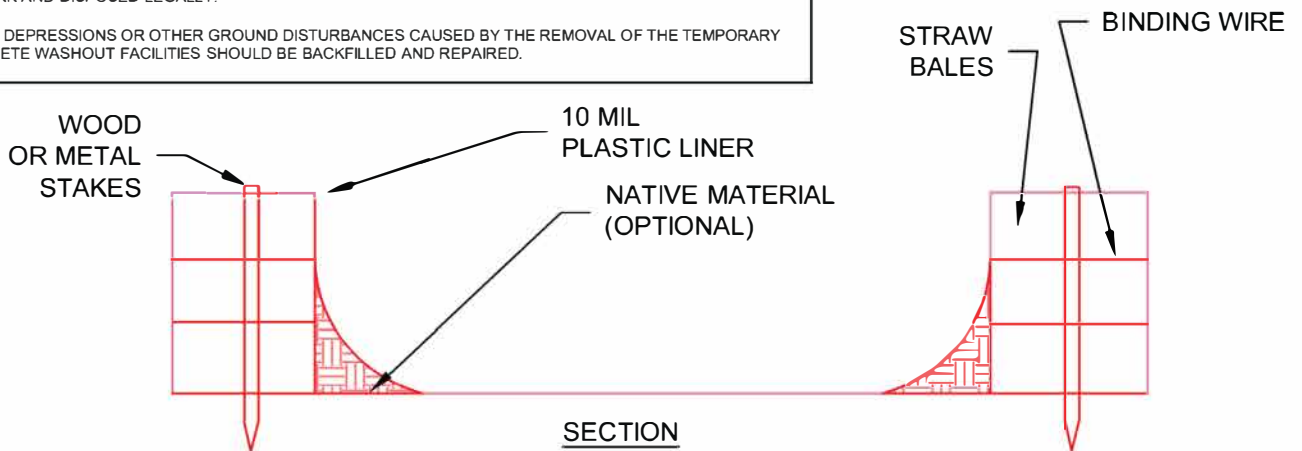

	NTS	CONCRETE WASHOUT ABOVE GRADE	PROJECT: _____	1.0
			DRAWN: CITY OF KYLE	
			DATE: 11/2021	